

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

SPONSOR: **OEG Building Materials**
Sayreville, NJ

Sound Transmission Loss
RAL™-TL24-435

CONDUCTED: 2024-09-24

Page 1 of 14

ON: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM E90-09 (2016): "Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements." The single number rating of the specimen was calculated according to ASTM E413-22: "Classification for Rating Sound Insulation." A description of the measurement procedure and room specifications is available upon request. The transmission loss values are for a single direction of measurement. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side. The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: Phantom 25 Tracks, Phantom 25 Studs, RC-MAX-18
Manufacturer: OEG Building Materials

SPECIMEN MEASUREMENTS & TEST CONDITIONS

The building contractor (Seth Priser) and RAL staff compiled a detailed construction specification as follows:

Tracks (Top & Bottom) (Product Under Test)

Material: Phantom 25 Tracks
Manufacturer: OEG Building Materials
Dimensions: 2 tracks @ 2448 mm (96.375 in.) wide by 32 mm (1.25 in.) high
Depth: 92 mm (3.625 in.)
Steel Thickness: 0.42 mm (0.01655 in.)
Installation: Friction fit over foam sill sealer
Overall Weight: 2.38 kg (5.25 lbs)
Mass per Unit Length: 0.49 kg/m (0.33 lbs/ft)



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY

WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 2 of 14

OEG Building Materials

2024-09-24

SPECIMEN MEASUREMENTS & TEST CONDITIONS (continued)

Studs (Product Under Test)

Material: Phantom 25 Studs
Manufacturer: OEG Building Materials
Dimensions: 5 studs @ 32 mm (1.25 in.) wide by 2740 mm (107.875 in.) high
Depth: 92 mm (3.625 in.)
Steel Thickness: 0.41 mm (0.01625 in.)
Stud Spacing: Studs spaced 610 mm (24 in.) on center
Installation: Side studs each fastened to test frame at midpoint with 1 screw each
Studs fastened to top and bottom tracks, 1 screw at each connection point
Fasteners: 8# wafer head stud screws, length @ 13 mm (0.5 in.)
Overall Weight: 6.8 kg (15 lbs)
Mass per Unit Length: 0.50 kg/m (0.33 lbs/ft)

Note: A bead of acoustical sealant was used to seal the source side of the specimen where framing members met the test frame (1.02 kg (2.25 lbs) total).

Insulation

Material: R-13 unfaced fiberglass
Dimensions: 4 pieces @ 610 mm (24 in.) wide by 2438 mm (96 in.) high
4 pieces @ 610 mm (24 in.) wide by 305 mm (12 in.) high
Depth: 92 mm (3.625 in.)
Installation: Friction fit between studs
Overall Weight: 7.03 kg (15.5 lbs)
Mass per Unit Volume: 11.4 kg/m³ (0.71 lbs/ft³)

Source Room Side

Resilient Channel (Product Under Test)

Material: RC-MAX-18
Manufacturer: OEG Building Materials
Dimensions: 6 pieces @ 2438 mm (96 in.) wide by 64 mm (2.5 in.) high
Depth: 13 mm (0.5 in.)
Steel Thickness: 0.5 mm (0.0195 in.)
Installation: Top and bottom rows spaced 102 mm (4 in.) apart from test frame
Other rows spaced 610 mm (24 in.) on center
Bottom row inverted
Fasteners: 8# wafer head stud screws, length @ 13 mm (0.5 in.)
Overall Weight: 3.97 kg (8.75 lbs)
Mass per Unit Length: 0.27 kg/m (0.18 lbs/ft)



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY

WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 3 of 14

OEG Building Materials

2024-09-24

SPECIMEN MEASUREMENTS & TEST CONDITIONS (continued)

Source Room Side (continued)

Base Layer

Material: Type X gypsum board
Dimensions: 2 panels @ 1219 mm (48 in.) wide by 2743 mm (108 in.) high
Thickness: 16 mm (0.625 in.)
Installation: Panels installed vertically and fastened to studs with screws
Fasteners: Type S bugle head drywall screws, length @ 25 mm (1 in.)
Fastener Spacing: 406 mm (16 in.) on center
Overall Weight: 73.6 kg (162.25 lbs)
Mass Per Unit Area: 11.00 kg/m² (2.25 lbs/ft²)

Face Layer

Dimensions: 1 panel @ 1219 mm (48 in.) wide by 2743 mm (108 in.) high
2 panels @ 610 mm (24 in.) wide by 2743 mm (108 in.) high
Thickness: 16 mm (0.625 in.)
Installation: Panels installed vertically and fastened to studs with screws
Panel joints staggered from source side base layer panel joints
Fasteners: Type S bugle head drywall screws, length @ 41 mm (1.625 in.)
Fastener Spacing: 406 mm (16 in.) on center
Overall Weight: 72.8 kg (160.5 lbs)
Mass Per Unit Area: 10.88 kg/m² (2.23 lbs/ft²)

Receive Room Side

Material: Type X gypsum board
Dimensions: 1 panel @ 1219 mm (48 in.) wide by 2743 mm (108 in.) high
2 panels @ 610 mm (24 in.) wide by 2743 mm (108 in.) high
Thickness: 16 mm (0.625 in.)
Installation: Panels installed vertically, fastened to studs with screws
Panel joints staggered from source side base layer panel joints
Fasteners: Type S bugle head drywall screws, length @ 32 mm (1.25 in.)
Fastener Spacing: 406 mm (16 in.) on center
Overall Weight: 73.71 kg (162.5 lbs)
Mass Per Unit Area: 11.02 kg/m² (2.26 lbs/ft²)

Note: Joints between gypsum board panels, and screw heads on both sides of the partition were treated with a thin bead of acoustical sealant and metal tape (0.45 kg (1 lbs) total).



NVLAP LAB CODE 100227-0

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY

WALLACE CLEMENT SABINE

OEG Building Materials

RAL™-TL24-435

2024-09-24

Page 4 of 14

SPECIMEN MEASUREMENTS & TEST CONDITIONS (continued)

Overall Specimen Measurements

Dimensions: 2.44 m (96.0 in) wide by 2.74 m (108.0 in) high
Thickness: 0.15 m (6.0 in)
Weight: 241.76 kg (533.0 lbs)
Overall Area: 6.689 m² (72. ft²)
Mass per Unit Area: 36.14 kg/m² (7.4 lbs/ft²)

Test Aperture

Opening Size: 2.74 m (9.0 ft.) by 4.27 m (14.0 ft.)
Filler Wall: Yes
Aperture Size: 2.44 m (96.0 in) wide by 2.74 m (108.0 in) high
Transmission Area: 6.689 m² (72. ft²)
Sealed: Entire periphery (both sides) with dense mastic

Test Environment

Source Room

Volume: 177.11 m³
Temperature: 22.2 °C ± 0.0 °C
Relative Humidity: 62.5 % ± 1.0 %

Receive Room

Volume: 178.33 m³
Temperature: 22.2 °C ± 0.0 °C
Relative Humidity: 60.5 % ± 1.0 %

Requirements

Temperature: 22° C +/- 2° C, not more than 3° C change over all tests.
Relative Humidity: ≥ 30%, not more than +/- 3% change over all tests.



NVLAP LAB CODE 100227-0

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
GENEVA, IL 60134

630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 5 of 14



Figure 1 – Specimen mounted in test aperture, as viewed from source room



Figure 2 – Specimen mounted in test aperture, as viewed from receive room

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

OEG Building Materials

RAL™-TL24-435

2024-09-24

Page 6 of 14



Figure 3 – Tracks, studs, and resilient channel installed in test aperture, view from source room side



Figure 4 – Detail of studs fastened to track and resilient channel fastened to studs

627 RIVERBANK DRIVE
GENEVA, IL 60134

630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 7 of 14



Figure 5 – Insulation installed in stud cavities, viewed from source room side



Figure 6 – Source room side base layer gypsum partially installed

627 RIVERBANK DRIVE
GENEVA, IL 60134

630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 8 of 14



Figure 7 – Source room side face layer partially installed



Figure 8 – Receive room side gypsum partially installed, view from receive room

627 RIVERBANK DRIVE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE
RAL™-TL24-435

Page 9 of 14

OEG Building Materials
 2024-09-24

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequency bands. A graphic presentation of the data and additional information appear on the following pages. The precision of the transmission loss test data is within the limits set by the ASTM Standard E90-09 (2016). See Appendix A for identification of corrections applied to the reported data.

<u>FREQ.</u>	<u>TL</u>	<u>ΔTL</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>TL</u>	<u>ΔTL</u>	<u>DEF.</u>
100	26	0.68	0	800	63	0.16	0
125	36	0.32	5	1000	65	0.09	0
160	40	0.37	4	1250	67	0.07	0
200	43	0.48	4	1600	64	0.08	0
250	47	0.33	3	2000	56	0.09	5
315	53	0.29	0	2500	57	0.08	4
400	55	0.41	1	3150	60	0.07	1
500	58	0.27	0	4000	64	0.07	0
630	60	0.16	0	5000	67	0.09	0

STC=57

ABBREVIATION INDEX

- FREQ. = 1/3 OCTAVE BAND CENTER FREQUENCY, Hz
- TL = TRANSMISSION LOSS, dB
- ΔTL = 95% CONFIDENCE INTERVAL FOR TL MEASUREMENTS, dB
- DEF. = DEFICIENCIES, dB BELOW SHIFTED STC CONTOUR (SUM OF DEF = 27)
- STC = SOUND TRANSMISSION CLASS

Tested by *Marc Sciaky*
 Marc Sciaky
 Senior Experimentalist

Report by *Keith Kimberling*
 Keith Kimberling
 Test Engineer

Approved by *Eric P. Wolfram*
 Eric P. Wolfram
 Laboratory Manager



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE


RAL™-TL24-435

Page 10 of 14

OEG Building Materials
 2024-09-24


SOUND TRANSMISSION REPORT

3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side

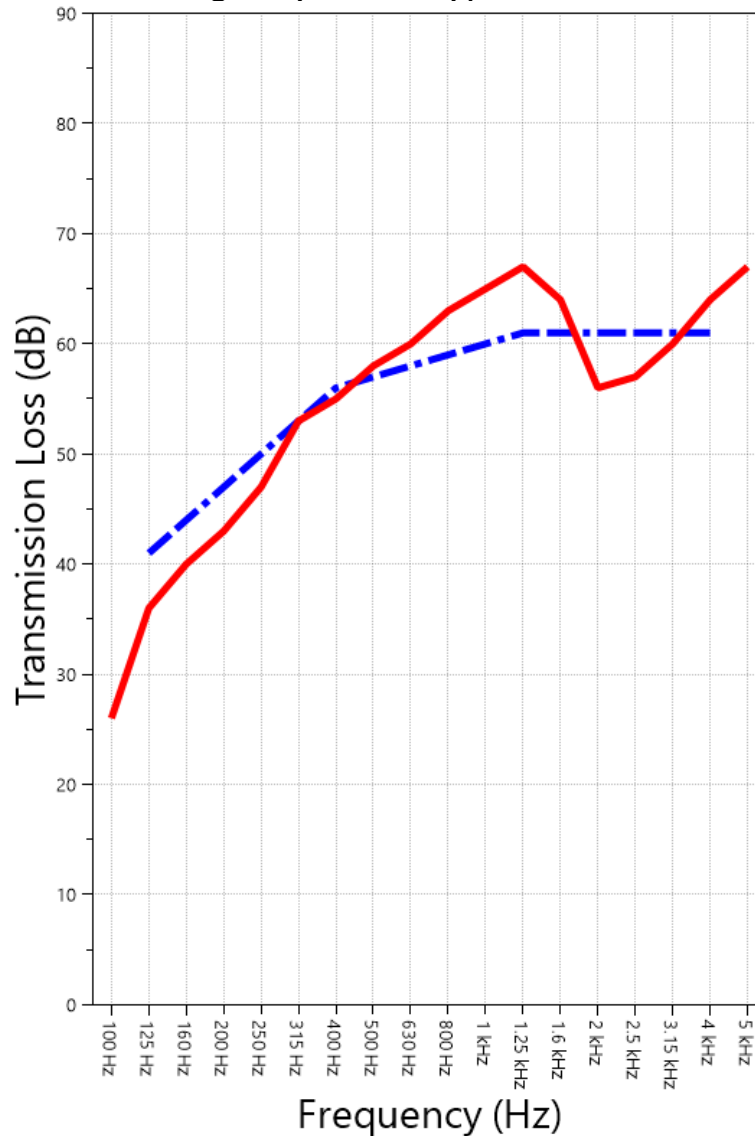

STC=57

OITC=36



TRANSMISSION LOSS

SOUND TRANSMISSION CLASS CONTOUR



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 11 of 14

OEG Building Materials

2024-09-24

APPENDIX A: Extended Frequency Range Data

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

The following non-accredited data were obtained in accordance with ASTM E90-09 (2016), but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes. Sampling precision observed during this procedure is reported below. Corrections are detailed in Appendix B.

1/3 Octave Band Center Frequency (Hz)	Sound Transmission Loss (dB)	Applicable Corrections	ΔTL (Eq. A2.5) (dB)	Repeatability (dB)
31.5	22	ZZ F	1.09	1.01
40	20	Z F	0.64	2.26
50	15		0.83	1.52
63	12		0.63	1.47
80	18		0.57	0.60
100	26		0.68	0.67
125	36	Z	0.32	0.71
160	40	Z F	0.37	0.35
200	43	Z F	0.48	0.33
250	47	Z F	0.33	0.42
315	53	Z	0.29	0.41
400	55		0.41	0.46
500	58		0.27	0.18
630	60		0.16	0.26
800	63		0.16	0.24
1000	65	Z F	0.09	0.27
1250	67	Z F	0.07	0.15
1600	64	Z	0.08	0.12
2000	56		0.09	0.13
2500	57		0.08	0.19
3150	60		0.07	0.14
4000	64		0.07	0.17
5000	67		0.09	0.17
6300	70	Z F	0.07	0.21
8000	69	Z F	0.07	0.50
10000	63	Z F	0.06	1.21
12500	57	Z F	0.07	1.74



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

APPENDIX B: Glossary of Standardized Corrections and Adjustments

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

Mark

Interpretation

A

Measured sound pressure levels in the receive room are within 10 dB of the ambient noise level at the marked frequency band. Receive room levels used to calculate Transmission Loss are corrected according to ASTM E90 Section 10.3.

AA

Measured sound pressure levels in the receive room are within 5 dB of the ambient noise level at the marked frequency band. Receive room levels used to calculate Transmission Loss are corrected according to ASTM E90 Section 10.3.1. Transmission Loss values calculated from levels corrected this way will be less than or equal to Transmission Loss values from a hypothetical test using the same specimen and a receive room with idealized ambient sound levels of $(-\infty)$ dB.

F

The reported Transmission Loss is within 10 dB of the laboratory flanking limit at the marked frequency band. The measured performance of the specimen may be limited by the performance of the laboratory building structure at this frequency band.

Z

The reported Transmission Loss at the marked frequency band has been corrected according to ASTM E90 Section A3.2.7 to account for possible sound transmission through the filler assembly.

ZZ

The reported Transmission Loss at the marked frequency band has been corrected according to ASTM E90 Section A3.2.8 to account for possible sound transmission through the filler assembly. Transmission Loss values corrected this way will be less than or equal to Transmission Loss values from a hypothetical test using the same specimen and an idealized filler assembly with a Sound Transmission Class rating of (∞) .

APPENDIX C: Glossary of Variability Metrics

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

Δ TL, the 95% confidence interval for reported transmission loss values, is calculated from the standard deviation of the sets of measurements for source room sound pressure level, receive room sound pressure level, and receive room sound absorption. This metric is calculated in an effort to quantify the combined influences of room geometry, microphone positioning, and other varying environmental conditions on reported results.

Repeatability, expressed as a 95% confidence interval, is calculated from the standard deviation of transmission loss as obtained from a set of six (6) consecutive tests conducted according to this test method by RAL on 2020-02-13. The tests were performed on a specimen composed of 24 gauge steel paneling, using the same test opening as used in this report. This metric provides an estimate of the variation in results that might be observed if the test were repeated with no change to the installed specimen. Note that repeatability will vary with the construction type.

627 RIVERBANK DRIVE
 GENEVA, IL 60134
 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

RAL™-TL24-435

Page 13 of 14

OEG Building Materials

2024-09-24

APPENDIX D: Determination of Outdoor Indoor Transmission Class (OITC)

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

The determination of the Outdoor Indoor Transmission Class (OITC) as reported below was made with explicit conformity to the procedures described in the ASTM E1332-22 test standard. Test Method ASTM E90-09 (2016) was used to obtain the sound transmission loss data. This rating is based on an average transportation noise source spectrum and an A-weighted sound level reduction, either of which may be inappropriate for some applications.

One-third Octave Band Center Frequency, Hz	Reference Sound Spectrum, dB	Test Specimen Transmission Loss, dB
80	103	18
100	102	26
125	101	36
160	98	40
200	97	43
250	95	47
315	94	53
400	93	55
500	93	58
630	91	60
800	90	63
1000	89	65
1250	89	67
1600	88	64
2000	88	56
2500	87	57
3150	85	60
4000	84	64

OITC = 36



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE
GENEVA, IL 60134

Test Report

www.riverbankacoustics.com

630-232-0104

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

OEG Building Materials

RAL™-TL24-435

2024-09-24

Page 14 of 14

APPENDIX E: Instruments of Traceability

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 2	3160-A-042	3160-106968	2024-07-19	2025-07-19
Bruel & Kjaer Mic And Preamp C	Type 4943-B-001	2311439	2024-03-29	2025-03-29
Bruel & Kjaer Pistonphone	Type 4228	2781248	2024-07-19	2025-07-19
EXTECH Hygro 663	SD700	A083663	2023-12-28	2024-12-28
EXTECH Hygro 639	SD700	A.103639	2023-12-01	2024-12-01

APPENDIX F: Revisions to Original Test Report

Specimen: 3-5/8" Phantom 25 Wall (24"o.c.) with OEG RC-MAX-18, Double Layer 5/8" Type-X on Source Side, Single Layer 5/8" Type-X on Receive Side (See Full Report)

<u>Date</u>	<u>Revision</u>
2024-10-11	Original report issued

END



NVLAP LAB CODE 100227-0

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.